

## 检测报告

编号 : SHMR251202962501\_CN  
日期 : 2025-12-23  
页码 : 1 of 4



扫描查看在线报告  
SHMR251202962501  
报告若真请访问:  
check.sgsgroup.com.cn

客户名称: 南京圣辉橡塑有限公司

客户地址: 南京市高淳区古柏镇韩村集镇 38 号

样品名称 : 橡胶垫

产品规格 : 3mm 厚

其他 : 耐电压 10kv

以上信息及样品由客户提供及确认, SGS 不承担证实客户提供信息的准确性、适当性和(或)完整性的责任。

\*\*\*\*\*

SGS 参考号 : SHIN2512011905PL01

收样日期 : 2025-12-16

测试开始时间 : 2025-12-16

测试结束时间 : 2025-12-23

测试结果 : 请见下页 (除另有特别说明外, 此报告结果仅对测试样品负责)

通标标准技术服务(上海)有限公司  
授权签名

曹洁敏

曹洁敏 授权签字人



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, independence and jurisdiction issues defined therein. Any holder of this document is advised that information contained herein reflects the Company's findings at the time of its inspection and is valid within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: [CN.Doccheck@sgs.com](mailto:CN.Doccheck@sgs.com)

No.69, Block 1159, Kangjiao East Road, Pudong District, Shanghai, China 201319

中国·上海·浦东康桥东路1159弄69号

邮编: 201319

t (86-21) 61196300 [www.sgsgroup.com.cn](http://www.sgsgroup.com.cn)

t (86-21) 61196300 [sgs.china@sgs.com](mailto:sgs.china@sgs.com)

Member of the SGS Group (SGS SA)

## 检测报告

编号 : SHMR251202962501\_CN  
日期 : 2025-12-23  
页码 : 2 of 4

结果总结:

序号	测试项目	测试方法	结果	结论
1	耐压试验	IEC 61111:2009 第 5.6.4.3 节	见结果	合格

备注: 合格: 达到要求

不合格: 未达到要求

/: 不下判定

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

**Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com**



| No.69, Block 1159, Kangjiao East Road, Pudong District, Shanghai, China 201319  
中国·上海·浦东康桥东路1159弄69号

| (86-21) 61196300 www.sgsgroup.com.cn  
t (86-21) 61196300 sgs.china@sgs.com

Member of the SGS Group (SGS SA)

## 检测报告

编号 : SHMR251202962501\_CN  
日期 : 2025-12-23  
页码 : 3 of 4

### 1. 测试项目: 耐压试验

样品描述: A-橡胶片材

测试方法: IEC 61111:2009 第 5.6.4.3 节

测试条件:

预处理条件: 水浸泡 16 h

周围媒质: (23±2) °C 变压器油

测试电极: 不等直径电极 (上电极 Ø25 mm、下电极 Ø75 mm)

电压类型: 交流 50 Hz

测试电压: 10 kV (级别 0)

测试时间: 3 min

实验室环境条件: (23 ± 2) °C, (50 ± 5) %RH

测试结果:

样品 A

试样	厚度, mm	泄漏电流, mA	外观
1	3.010	<0.5	未击穿或闪络
2	2.991	<0.5	未击穿或闪络
3	2.978	<0.5	未击穿或闪络
4	3.003	<0.5	未击穿或闪络
5	3.006	<0.5	未击穿或闪络

备注: 泄漏电流低于设备测量下限 (<0.5 mA)

IEC 61111:2009 第 5.6.4.3 节要求: 未击穿或闪络

结论: 合格



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: [CN.Doccheck@sgs.com](mailto:CN.Doccheck@sgs.com)

| No.69, Block 1159, Kangjiao East Road, Pudong District, Shanghai, China 201319

t (86-21) 61196300 [www.sgsgroup.com.cn](http://www.sgsgroup.com.cn)


中国·上海·浦东康桥东路1159弄69号 邮编: 201319

t (86-21) 61196300 [sgs.china@sgs.com](mailto:sgs.china@sgs.com)

## 检测报告

编号 : SHMR251202962501\_CN  
日期 : 2025-12-23  
页码 : 4 of 4

测试照片:

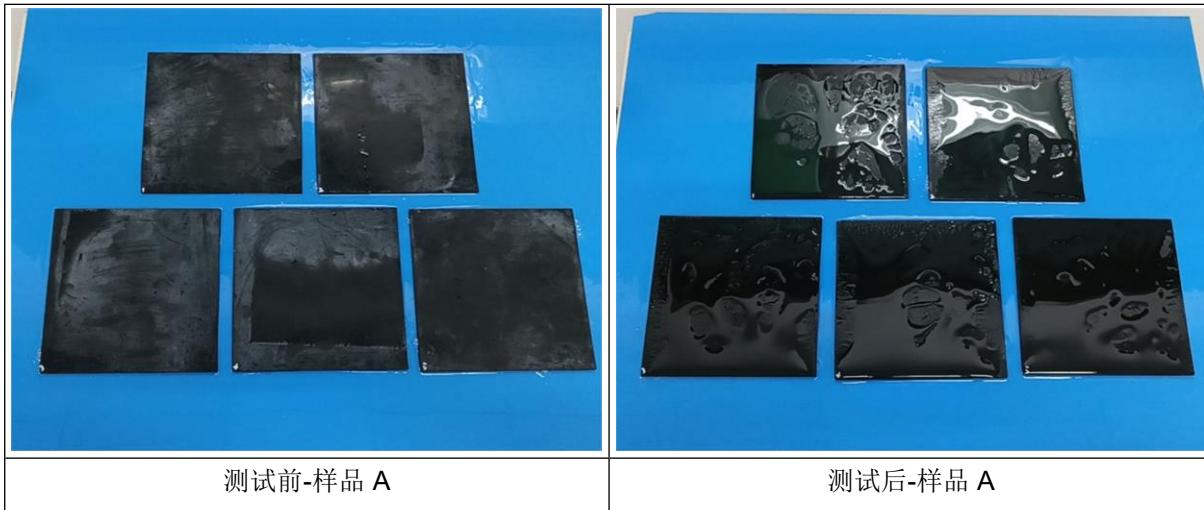

设备信息:

设备	型号	设备编号	校准日期	下次校准日期
高压试验仪	JTKZ-1	P-207	2025-10-13	2026-10-12
数显测厚规	EK091711	P-1034	2025-12-02	2026-12-01

附录信息:

\*除非另有说明, 参照 ILAC-G8:09/2019, 使用简单接受 ( $w=0$ ) 的二元判定规则进行符合性判定。

\*检测报告仅用于客户科研、教学、内部质量控制、产品研发等目的, 仅供内部参考。

\*\*\*\*\* 报告结束\*\*\*\*\*



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: [CN.Doccheck@sgs.com](mailto:CN.Doccheck@sgs.com)

SGS-CSTC Materials & Reliability Technical Services (Shanghai) Co., Ltd.  
Materials & Reliability Laboratory  
中国·上海·浦东康桥东路1159弄69号 邮编: 201319

t (86-21) 61196300 [www.sgsgroup.com.cn](http://www.sgsgroup.com.cn)  
t (86-21) 61196300 [sgs.china@sgs.com](mailto:sgs.china@sgs.com)

Member of the SGS Group (SGS SA)